AnTek Inc.
www.antekinc.com

AS-09T340 100VA Toroidal Transformers

These 100VA toroidal tube audio power transformers feature a static shield between the primary and secondary windings to improve electrical isolation and reduce noise interference. A magnetic shield around the outside of the transformer further reduces magnetic leakage, helping minimize hum and interference in sensitive audio applications.

With these advanced features, these transformers are specially designed for high-quality tube audio equipment. They are compatible with standard 115V or 230V input at 50Hz or 60Hz.

The transformers use heavier-gauge copper wire than normally required, helping minimize copper losses and voltage drop when operating at full power. Each transformer is also tested for dielectric leakage between the primary and secondary windings at up to 3500VAC to ensure excellent electrical isolation.

Each transformer includes two rubber isolation pads, a mounting disk, and a center bolt assembly for easy installation.

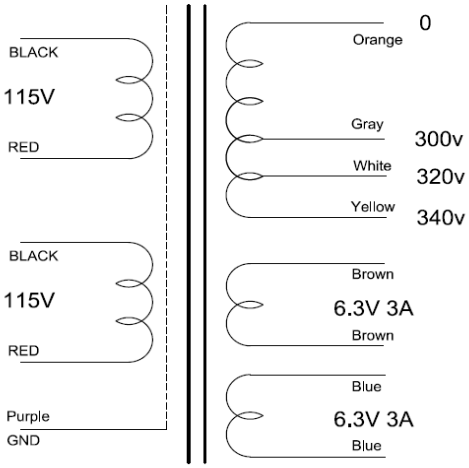

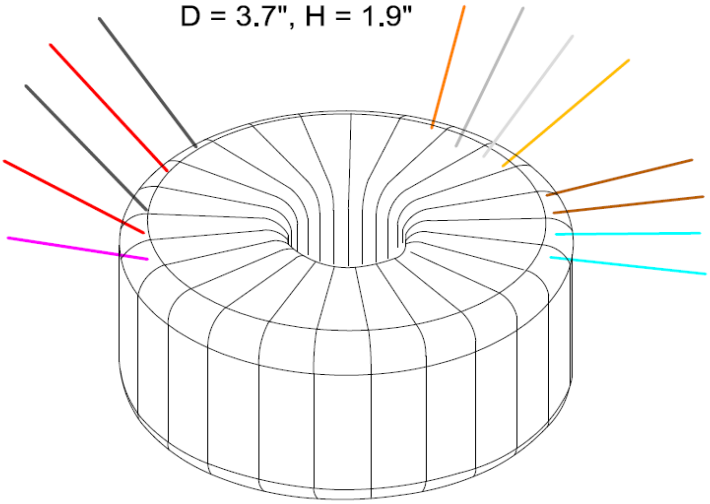

Open Circuit Test (core loss test): TEST CONDITION: Apply variable voltage to primary coils (in parallel). Set voltages 120 and 140VAC at 60Hz. No load on secondary coils. Measure the primary current and input power.	Voltage input	Current input	Power lost
	120V 140V	.01A .01A	0.8W 1.2W
Short Circuit Test (copper loss test): TEST CONDITION: Short all secondary coils, and apply variable voltage to (parallel) primary coils. Varies the voltage from 0-20VAC at 60Hz and freeze the voltage at rated primary current.	Voltage input	Current rated	Power lost
	7.2V	0.85A	5W
Load Test (operation test):** TEST CONDITION: Input 120VAC 60Hz to the primary coils (in parallel), Output (orange-yellow) to load, and measure voltage and current at different load levels.	Voltage output	Current output	Power output
	356V 330V	0.0A 0.17A	0W 58W
DC Resistant Test: DC OHM METER: Test each coil from primary (red-black) and secondary (Hv: orange-yellow & Lv: blue-blue)	Primary	Hv	Lv
	9.6Ω	74Ω	0.1Ω

**Note: The values shown are not the maximum power rating of the transformer. They are test data used to determine the transformer's effective output impedance. The loaded output voltage can be estimated as Vout = Vno-load − I × Z, where Z = ΔV / ΔI.

29 Ewing Ave.
N. Arlington, NJ 07031

Tel: 201-991-3300
sales@antekinc.com